

LONG RAMPS: SHOULD INCLUDE LEVEL RESTING PLACES AT 90 M(29'-6") INTERVALS




NOTES:

1) ONTARIO BUILDING CODE REQUIREMENTS FOR BARRIER FREE RAMPS DO NOT APPLY TO:

- A) HOUSES, INCLUDING SEM-DETACHED HOUSES, DUPLEXES, TRIPLEXES, TOWN HOUSES, ROW HOUSES AND BOARDING OR ROOMING HOUSES WITH FEWER THAN 8 BOARDERS OR ROOMERS
- B) BUILDINGS OF GROUP F, DIVISION I MAJOR OCCUPANCY, AND
- C) BUILDINGS WHICH ARE NOT INTENDED TO BE OCCUPIED ON A DAILY OR FULL TIME BASIS, INCLUDING AUTOMATIC TELEPHONE EXCHANGES, PUMPHOUSES AND SUBSTATIONS.

2) GUARDS

A) EVERY EXIT SUCH AS A RAMP, STAIRWAY, OR PASSAGE WAY SHALL HAVE A WALL OR A WELL-SECURED GUARD ON EACH SIDE

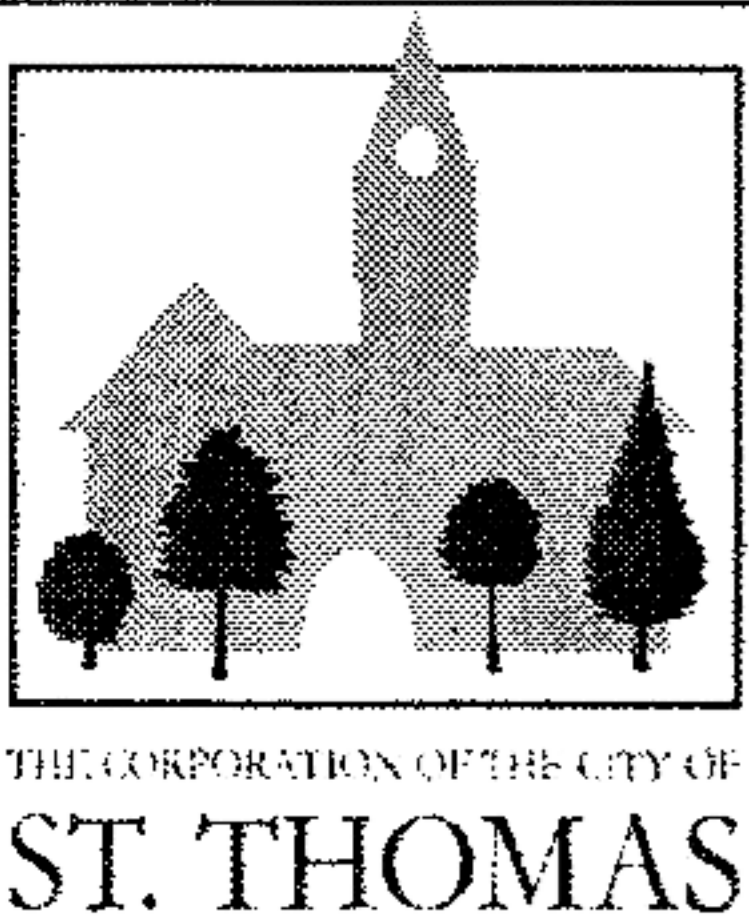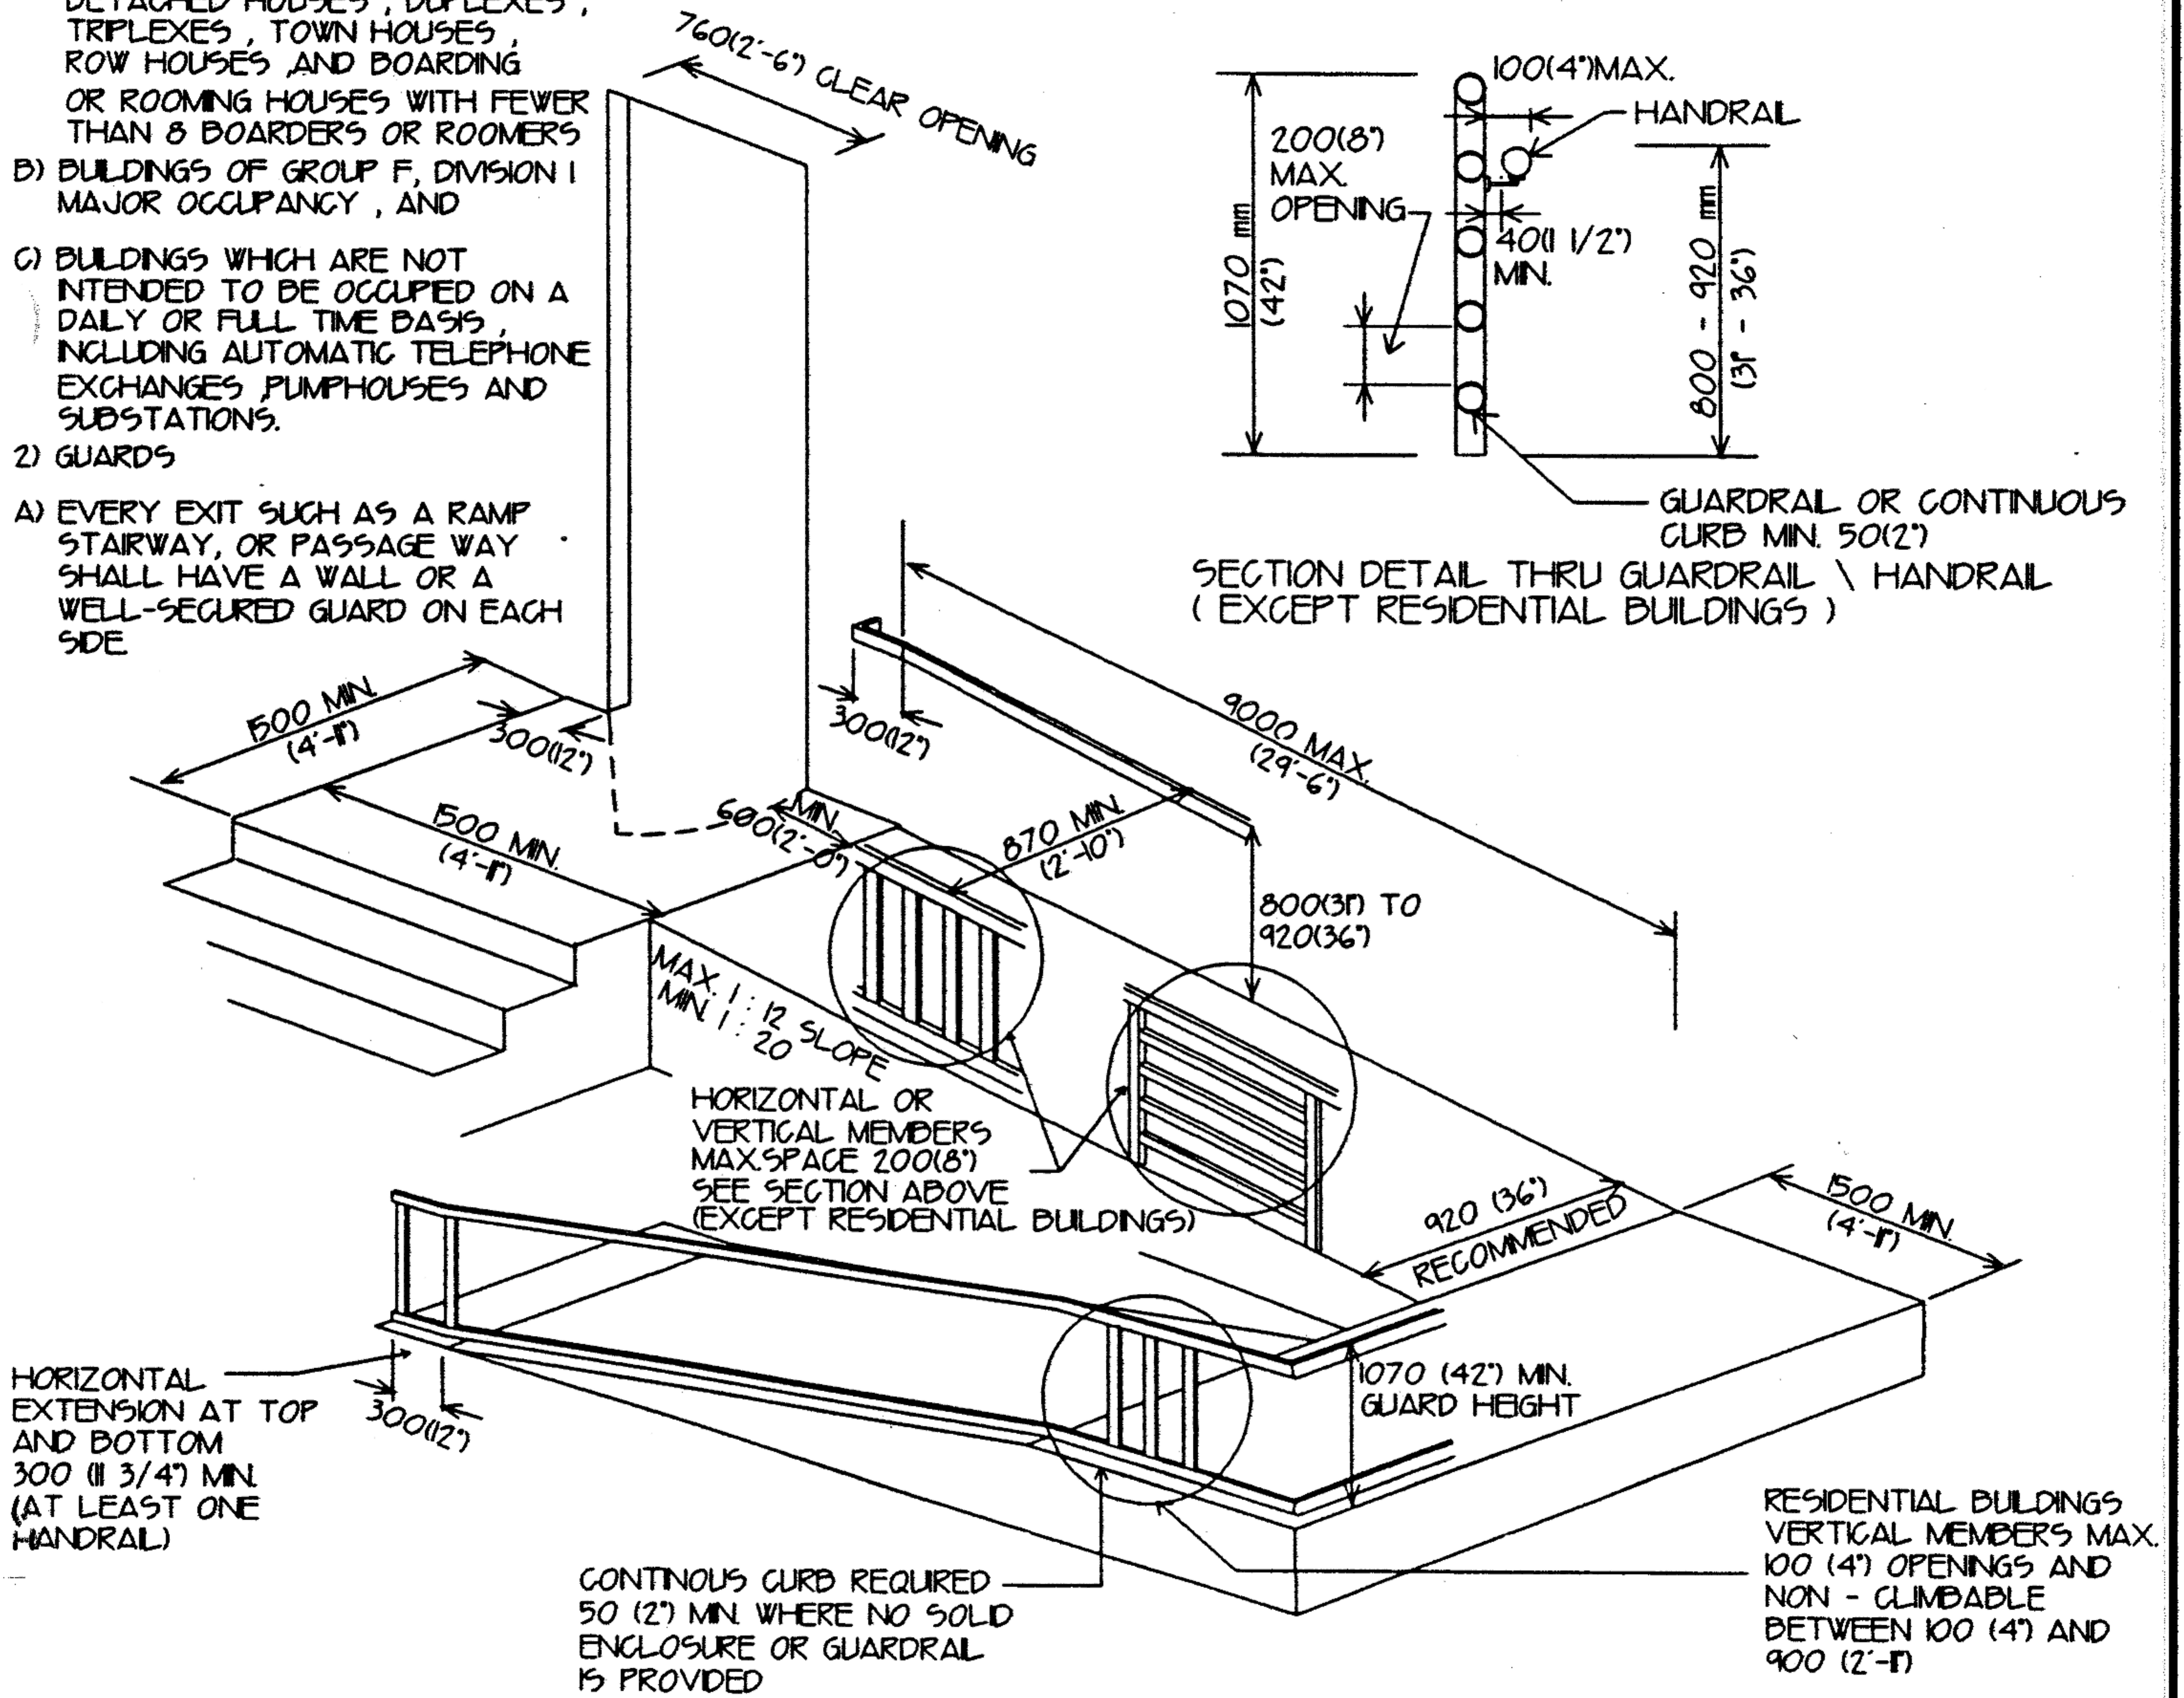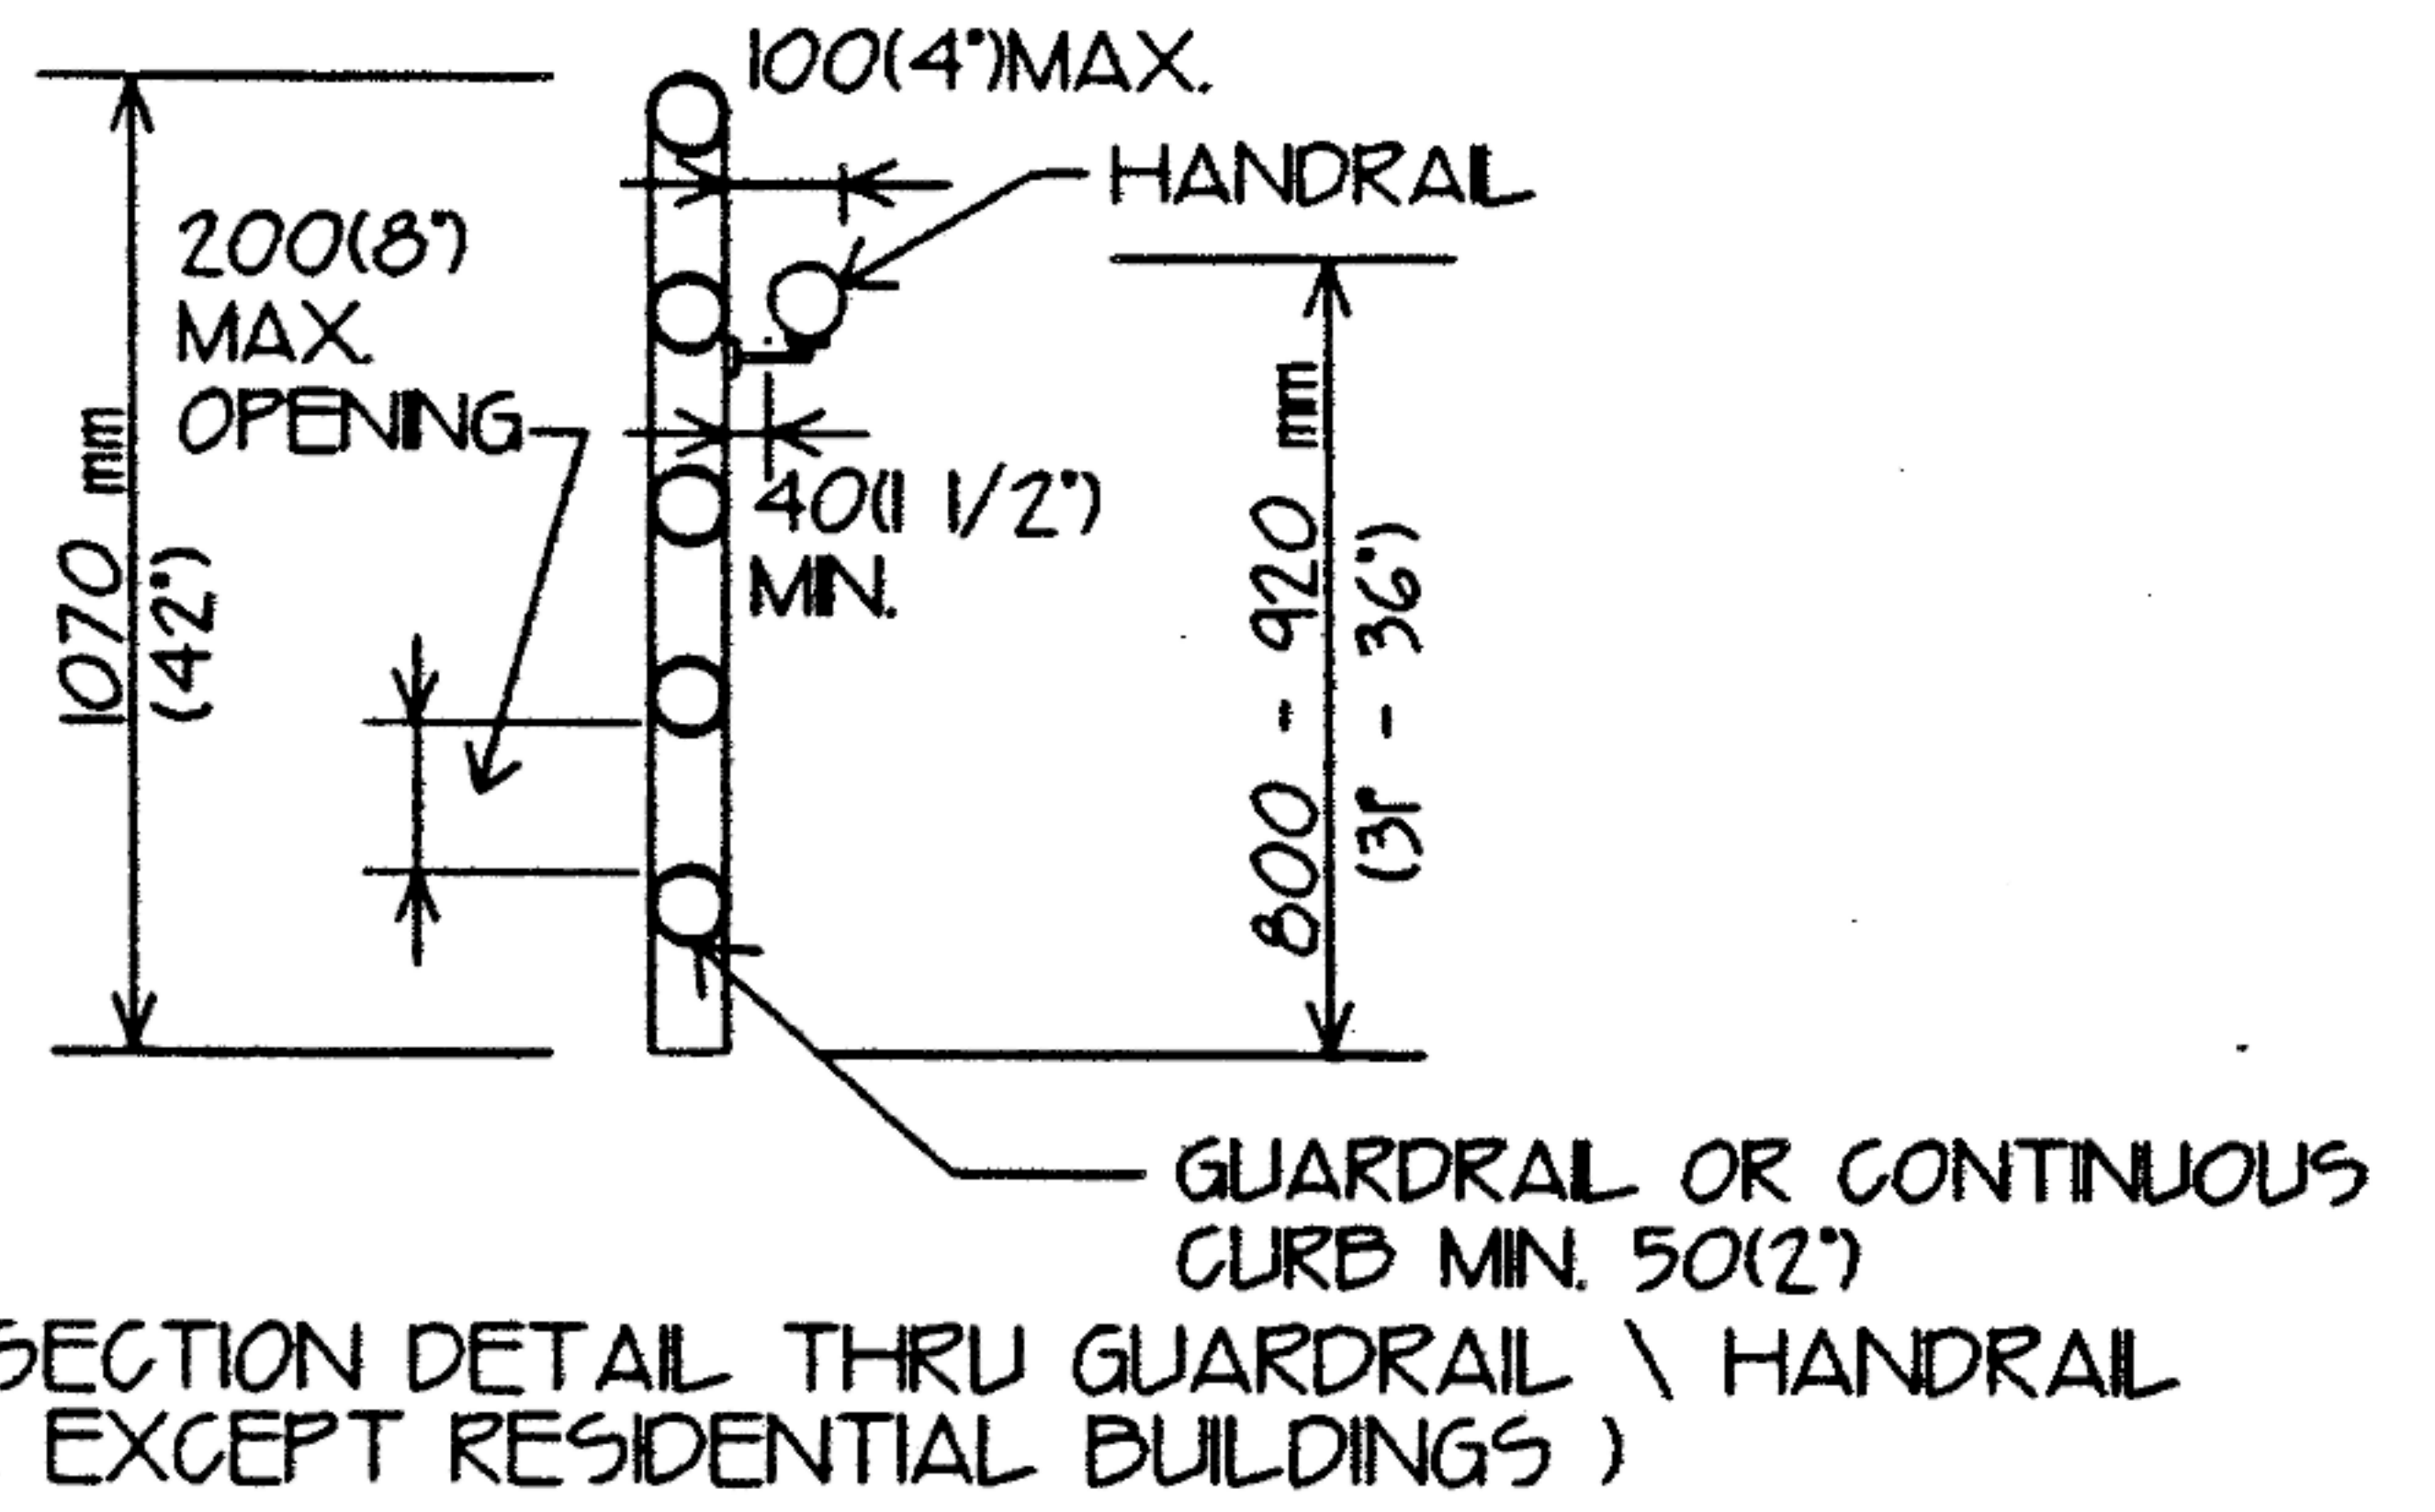

Environmental Services – Building Services

April 2009

Sample Drawings
Barrier Free Ramps

BF01